

MAIN BREAKER WIRING (TYPICAL)


SERVICE GROUND IS TYPICALLY TIED TO NEUTRAL AT THE MAIN BREAKER. AS SUCH, CONTROLLER GROUND IS NOT TIED TO NEUTRAL AT SECONDARY BREAKER OR IN CONTROLLER CABINET.

NOTES:

LOCATION OF SERVICE:
TO MEET THE REQUIREMENTS FOR SAFETY AND MAXIMIZE LIGHTNING PROTECTION, THE "SERVICE POINT MAIN" FROM THE UTILITY PRIMARY SERVICE POINT MUST BE WITHIN SIX (6') FEET OF THE TRAFFIC SIGNAL CONTROLLER CABINET. ELECTRICAL SERVICE SHALL BE PROVIDED BY THE CITY/COUNTY TO A SERVICE POLE OR PEDESTAL WITH EXTERNAL RAIN-TIGHT BREAKER (MAIN BREAKER) AT A MUTUALLY ACCEPTABLE POINT WITHIN THE RIGHT-OF-WAY. SERVICE POINT INCLUDES GALVANIZED STEEL CONDUIT TO A POLE 18" BELOW GROUND LINE, TWO CIRCUIT MAIN BREAKER, POWER ISOLATION ASSEMBLY WHERE REQUIRED, METER LOOP IF REQUIRED BY LOCAL UTILITY COMPANY, ELECTRICAL CONDUCTORS AND WEATHERHEAD. WHERE STREET LIGHTING IS INCLUDED AS PART OF SIGNAL INSTALLATION, STREET LIGHTING CIRCUIT (2C/#12 A.W.G. UF RATED, TYPICAL) SHALL BE KEPT SEPARATE FROM THE CIRCUIT SERVING TRAFFIC SIGNAL. SERVICE WIRE AND WIRING FROM THE CONTROLLER TO MAIN BREAKER IS PROVIDED BY THE CONTRACTOR AS A PART OF THIS CONTRACT. WIRE AND WIRING FROM MAIN RESPONSIBILITY OF THE CITY/COUNTY.

METER LOOP:
ALL COMPONENTS OF THE SERVICE POINT WITH THE EXCEPTION OF THE WIRE AND WIRING ABOVE THE MAIN BREAKER IS FURNISHED AND INSTALLED BY THE CONTRACTOR. WIRING FROM MAIN BREAKER INCLUDING CONNECTION TO THE UTILITY, IS THE RESPONSIBILITY OF THE CITY/COUNTY. IF METER LOOP IS REQUIRED, METER BASE AND HARDWARE IS PROVIDED BY THE CITY/COUNTY AND INSTALLED BY THE CONTRACTOR.

SUPPLEMENT GROUND RODS:
SUPPLEMENT GROUND RODS ARE FUSION WELDED TO IC/#8 A.W.G. SOLID COPPER GROUND WIRE. ATTACHMENT TO PRIMARY GROUND MAY BE AN APPROVED CLAMP. GROUND RODS ARE LOCATED IN A BOX APPROVED BY THE ENGINEER MEETING THE SAME LOADING REQUIREMENTS AS SECTION 711 CONCRETE PULL BOX OF THE STANDARD SPECIFICATIONS, WITH THE EXCEPTION TO DIMENSIONS. THE CONCRETE PULL BOX MAY BE EITHER ROUND OR SQUARE APPROXIMATELY SIX (6") INCHES MINIMUM INSIDE DIMENSIONS AND SIX (6") INCHES DEPTH. (STRONGWELL PC0608BA06 WITH PC0608CA00 LID OR EQUAL).

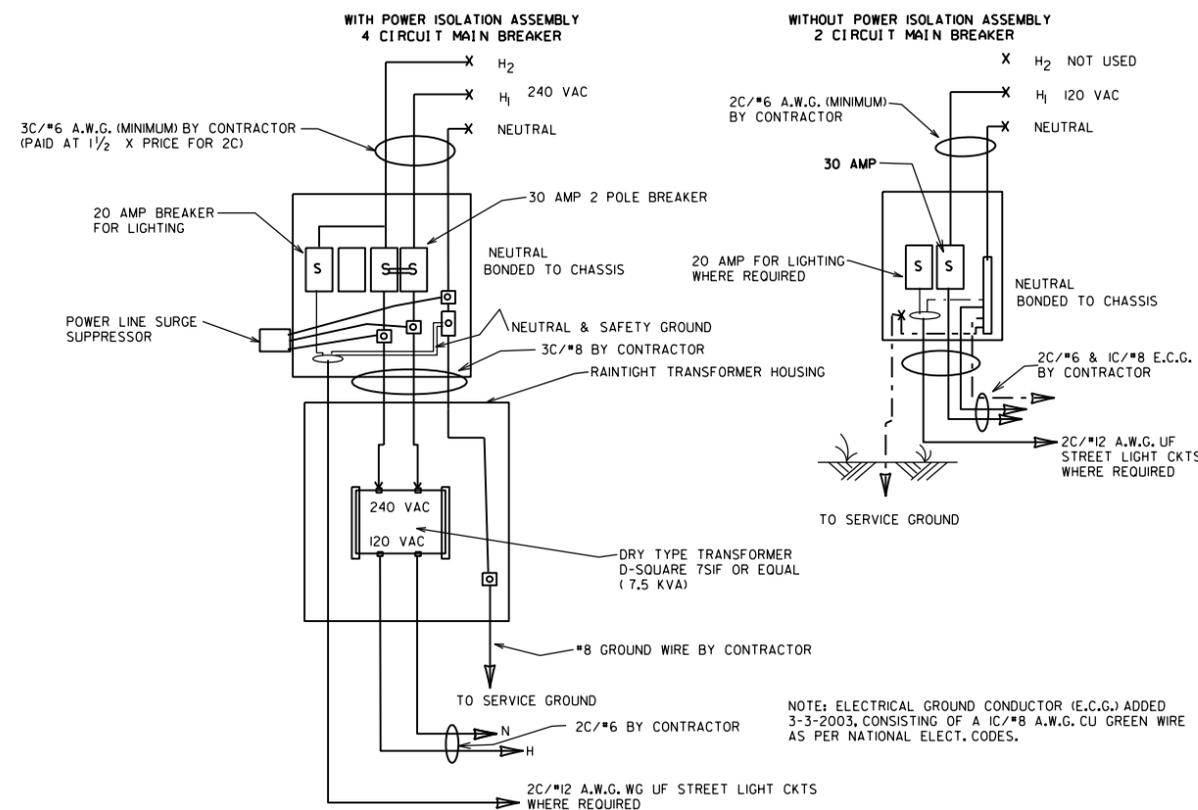

			ARKANSAS STATE HIGHWAY COMMISSION
			SERVICE POINT INSTALLATION WITH SUPPLEMENT GROUNDING ARRAY
			STANDARD DRAWING SD-12
11-07-19	REVISED NOTES		
11-16-17	REVISED NOTES		
09-12-13	ISSUED AS STANDARD DRAWING		
01-17-08	ISSUED		
DATE	REVISION		FILMED